U.L. 142 SECONDARY CONTAINMENT A.S.T.

(SHALL NOT EXCEED 12,000 GALLONS)
EXCEPT FLEET FUELING

Protection by Distance

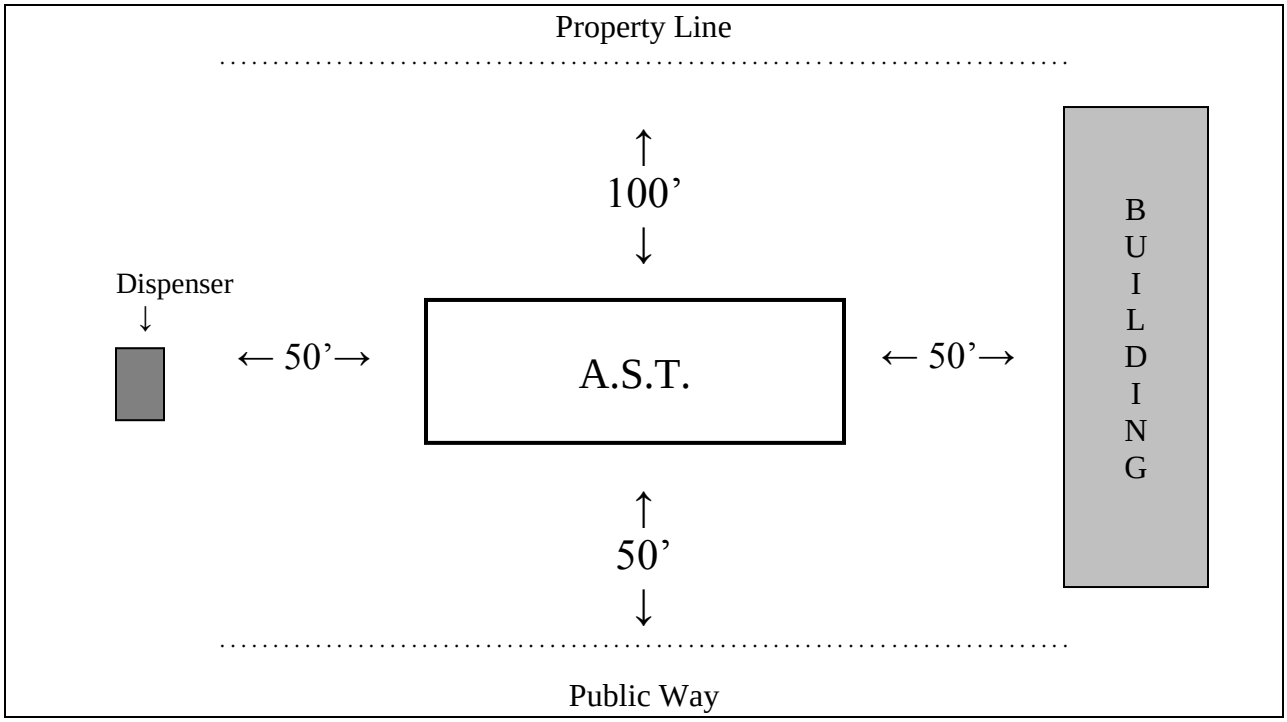

N.F.P.A. 30A 2015 ed.
N.F.P.A. 30 2015 ed.

If Vehicle Impact Protection is needed, please refer to Section 312 of 2012 International Fire Code.