



DITCH DETAIL AT HANDHOLE
NOT TO SCALE

1. PLACEMENT OF DUCT BANK AND BACKFILL SHALL BE PER SECTION 02580 UNDERGROUND DUCT BANK.
2. PLACEMENT OF HAND HOLES SHALL BE PER KUB SECTION 02585 ELECTRIC MANHOLES AND HAND HOLES
3. ALL CONDUIT TO HAVE 3" MINIMUM COVER IN ALL DIRECTIONS.
4. DUCTLINE WARNING TAPE SHALL BE PLACED 12" ABOVE TOP CONDUIT.

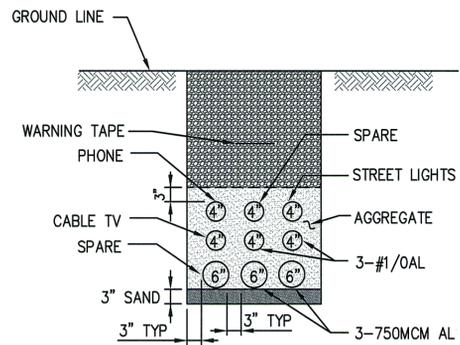

TYPICAL MAIN LINE DITCH DETAIL
NOT TO SCALE

1. PLACEMENT OF DUCT BANK AND BACKFILL SHALL BE PER KUB SECTION 02580 - UNDERGROUND DUCT BANK.
2. ALL CONDUIT TO HAVE 3" MINIMUM COVER IN ALL DIRECTIONS.
3. DUCTLINE WARNING TAPE SHALL BE PLACED 12" ABOVE TOP CONDUIT.

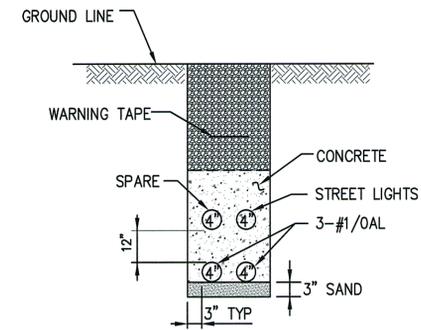

DITCH DETAIL AT ROAD CROSSING
NOT TO SCALE

1. PLACEMENT OF DUCT BANK AND BACKFILL SHALL BE PER KUB SECTION 02580 - UNDERGROUND DUCT BANK.
2. ALL CONDUIT TO HAVE 3" MINIMUM COVER IN ALL DIRECTIONS.
3. DUCTLINE WARNING TAPE SHALL BE PLACED 12" ABOVE TOP CONDUIT.



REVISIONS _____ DATE _____

Cannon & Cannon, Inc.
Consulting Engineers • Field Surveyors
8550 Kingston Pike
Knoxville, Tennessee 37919
Telephone: (865) 670-8555 • Fax: (865) 670-8866
www.cannon-cannon.com

CLIENT:
**CITY OF KNOXVILLE
SOUTH WATERFRONT DEVELOPMENT
DEPARTMENT**

PROJECT:
**BLOUNT AVENUE
RECONSTRUCTION PROJECT**

ELECTRIC DETAILS

	CCI PROJECT NO.	00244-0005
	DATE	2-27-2009
	P.I.C.	LPB
	DRAWN	MN
	C.C.	JSD

E2.01